SIEMENS

Data sheet

3RB2163-4GF2




Overload relay 55...250 A for motor protection Size S10/S12, CLASS 5...30E Contactor mounting/stand-alone installation Main circuit: busbar connection Auxiliary circuit: Spring-type terminal Manual-Automatic-Reset Internal ground fault detection


product brand name	SIRIUS			
product designation	solid-state overload relay			
product type designation	3RB2			
General technical data				
size of overload relay	S10, S12			
size of contactor can be combined company-specific	S10, S12			
insulation voltage with degree of pollution 3 at AC rated value	1 000 V			
surge voltage resistance rated value	8 kV			
maximum permissible voltage for protective separation				
 in networks with ungrounded star point between auxiliary and auxiliary circuit 	300 V			
 in networks with grounded star point between auxiliary and auxiliary circuit 	300 V			
 in networks with ungrounded star point between main and auxiliary circuit 	600 V			
 in networks with grounded star point between main and auxiliary circuit 	690 V			
shock resistance	15g / 11 ms			
 according to IEC 60068-2-27 	15g / 11 ms; Signaling contact 97 / 98 in position "Tripped": 8g / 11 ms			
vibration resistance	1-6 Hz, 15 mm; 6-500 Hz, 20 m/s²; 10 cycles			
thermal current	250 A			
recovery time after overload trip				
 with automatic reset typical 	3 min			
with remote-reset	0 min			
 with manual reset 	0 min			
reference code according to IEC 81346-2	F			
Substance Prohibitance (Date)	07/01/2006			
SVHC substance name	Lead - 7439-92-1 Lead monoxide (lead oxide) - 1317-36-8			
Weight	1.613 kg			
Ambient conditions				
installation altitude at height above sea level maximum	2 000 m			
ambient temperature				
during operation	-25 +60 °C			
during storage	-40 +80 °C			
during transport	-40 +80 °C			
temperature compensation	-25 +60 °C			
relative humidity during operation	10 95 %			
Main circuit				
number of poles for main current circuit	3			
adjustable current response value current of the current- dependent overload release	55 250 A			

operating voltage	
 rated value 	1 000 V
 for remote-reset function at DC 	24 V
 at AC-3e rated value maximum 	1 000 V
operating frequency rated value	50 60 Hz
operational current rated value	250 A
operational current at AC-3e at 400 V rated value	250 A
operating power	
 for 3-phase motors at 400 V at 50 Hz 	30 132 kW
 for AC motors at 500 V at 50 Hz 	45 160 kW
 for AC motors at 690 V at 50 Hz 	55 250 kW
Auxiliary circuit	
design of the auxiliary switch	integrated
number of NC contacts for auxiliary contacts	1
note	for contactor disconnection
number of NO contacts for auxiliary contacts	1
note	for message "tripped"
	0
number of CO contacts for auxiliary contacts	0
operational current of auxiliary contacts at AC-15	4.4
• at 24 V	4 A 4 A
• at 110 V	4 A
• at 120 V	4 A
• at 125 V	4 A
• at 230 V	3 A
operational current of auxiliary contacts at DC-13	
• at 24 V	2 A
• at 60 V	0.55 A
● at 110 V	0.3 A
● at 125 V	0.3 A
• at 220 V	0.11 A
Protective and monitoring functions	
Protective and monitoring functions trip class	CLASS 5E, 10E, 20E and 30E adjustable
	CLASS 5E, 10E, 20E and 30E adjustable electronic
trip class	
trip class design of the overload release	electronic
trip class design of the overload release response value current of the grounding protection minimum	electronic 0.75 x IMotor
trip class design of the overload release response value current of the grounding protection minimum response time of the grounding protection in settled state operating range of the grounding protection relating to	electronic 0.75 x IMotor
trip class design of the overload release response value current of the grounding protection minimum response time of the grounding protection in settled state operating range of the grounding protection relating to current set value	electronic 0.75 x IMotor 1 000 ms
trip class design of the overload release response value current of the grounding protection minimum response time of the grounding protection in settled state operating range of the grounding protection relating to current set value • minimum	electronic 0.75 x IMotor 1 000 ms IMotor > lower current setting value
trip class design of the overload release response value current of the grounding protection minimum response time of the grounding protection in settled state operating range of the grounding protection relating to current set value • minimum • maximum	electronic 0.75 x IMotor 1 000 ms IMotor > lower current setting value
trip class design of the overload release response value current of the grounding protection minimum response time of the grounding protection in settled state operating range of the grounding protection relating to current set value • minimum • maximum UL/CSA ratings	electronic 0.75 x IMotor 1 000 ms IMotor > lower current setting value
trip class design of the overload release response value current of the grounding protection minimum response time of the grounding protection in settled state operating range of the grounding protection relating to current set value • minimum • maximum UL/CSA ratings full-load current (FLA) for 3-phase AC motor	electronic 0.75 x IMotor 1 000 ms IMotor > lower current setting value IMotor < upper current setting value x 3.5
trip class design of the overload release response value current of the grounding protection minimum response time of the grounding protection in settled state operating range of the grounding protection relating to current set value • minimum • maximum UL/CSA ratings full-load current (FLA) for 3-phase AC motor • at 480 V rated value	electronic 0.75 x IMotor 1 000 ms IMotor > lower current setting value IMotor < upper current setting value x 3.5 250 A
trip class design of the overload release response value current of the grounding protection minimum response time of the grounding protection in settled state operating range of the grounding protection relating to current set value • minimum • maximum UL/CSA ratings full-load current (FLA) for 3-phase AC motor • at 480 V rated value • at 600 V rated value	electronic 0.75 x IMotor 1 000 ms IMotor > lower current setting value IMotor < upper current setting value x 3.5 250 A 250 A
trip class design of the overload release response value current of the grounding protection minimum response time of the grounding protection in settled state operating range of the grounding protection relating to current set value • minimum • maximum UL/CSA ratings full-load current (FLA) for 3-phase AC motor • at 480 V rated value • at 600 V rated value contact rating of auxiliary contacts according to UL Short-circuit protection	electronic 0.75 x IMotor 1 000 ms IMotor > lower current setting value IMotor < upper current setting value x 3.5 250 A 250 A
trip class design of the overload release response value current of the grounding protection minimum response time of the grounding protection in settled state operating range of the grounding protection relating to current set value • minimum • maximum UL/CSA ratings full-load current (FLA) for 3-phase AC motor • at 480 V rated value • at 600 V rated value contact rating of auxiliary contacts according to UL Short-circuit protection design of the fuse link	electronic 0.75 x IMotor 1 000 ms IMotor > lower current setting value IMotor < upper current setting value x 3.5 250 A 250 A
trip class design of the overload release response value current of the grounding protection minimum response time of the grounding protection in settled state operating range of the grounding protection relating to current set value • minimum • maximum UL/CSA ratings full-load current (FLA) for 3-phase AC motor • at 480 V rated value • at 600 V rated value contact rating of auxiliary contacts according to UL Short-circuit protection design of the fuse link • for short-circuit protection of the main circuit	electronic 0.75 x IMotor 1 000 ms IMotor > lower current setting value IMotor < upper current setting value x 3.5 250 A 250 A B600 / R300
trip class design of the overload release response value current of the grounding protection minimum response time of the grounding protection in settled state operating range of the grounding protection relating to current set value • minimum • maximum UL/CSA ratings full-load current (FLA) for 3-phase AC motor • at 480 V rated value • at 600 V rated value contact rating of auxiliary contacts according to UL Short-circuit protection design of the fuse link • for short-circuit protection of the main circuit — with type of coordination 1 required	electronic 0.75 x IMotor 1 000 ms IMotor > lower current setting value IMotor < upper current setting value x 3.5 250 A 250 A 250 A B600 / R300 gG: 500 A, Class L: 700 A
trip class design of the overload release response value current of the grounding protection minimum response time of the grounding protection in settled state operating range of the grounding protection relating to current set value • minimum • maximum UL/CSA ratings full-load current (FLA) for 3-phase AC motor • at 480 V rated value • at 600 V rated value contact rating of auxiliary contacts according to UL Short-circuit protection design of the fuse link • for short-circuit protection of the main circuit — with type of coordination 1 required — with type of assignment 2 required	electronic 0.75 x IMotor 1 000 ms IMotor > lower current setting value IMotor < upper current setting value x 3.5 250 A 250 A 250 A B600 / R300 gG: 500 A, Class L: 700 A gG: 500 A
trip class design of the overload release response value current of the grounding protection minimum response time of the grounding protection in settled state operating range of the grounding protection relating to current set value • minimum • maximum UL/CSA ratings full-load current (FLA) for 3-phase AC motor • at 480 V rated value • at 600 V rated value contact rating of auxiliary contacts according to UL Short-circuit protection design of the fuse link • for short-circuit protection of the main circuit — with type of coordination 1 required — with type of assignment 2 required • for short-circuit protection of the auxiliary switch required	electronic 0.75 x IMotor 1 000 ms IMotor > lower current setting value IMotor < upper current setting value x 3.5 250 A 250 A 250 A B600 / R300 gG: 500 A, Class L: 700 A
trip class design of the overload release response value current of the grounding protection minimum response time of the grounding protection in settled state operating range of the grounding protection relating to current set value • minimum • maximum UL/CSA ratings full-load current (FLA) for 3-phase AC motor • at 480 V rated value • at 600 V rated value contact rating of auxiliary contacts according to UL Short-circuit protection design of the fuse link • for short-circuit protection of the main circuit — with type of coordination 1 required — with type of assignment 2 required • for short-circuit protection of the auxiliary switch required Installation/ mounting/ dimensions	electronic 0.75 x IMotor 1 000 ms IMotor > lower current setting value IMotor < upper current setting value x 3.5 250 A 250 A 250 A B600 / R300 G: 500 A, Class L: 700 A gG: 500 A fuse gG: 6 A
trip class design of the overload release response value current of the grounding protection minimum response time of the grounding protection in settled state operating range of the grounding protection relating to current set value • minimum • maximum UL/CSA ratings full-load current (FLA) for 3-phase AC motor • at 480 V rated value • at 600 V rated value contact rating of auxiliary contacts according to UL Short-circuit protection design of the fuse link • for short-circuit protection of the main circuit — with type of coordination 1 required — with type of assignment 2 required • for short-circuit protection of the auxiliary switch required Installation/ mounting/ dimensions mounting position	electronic 0.75 x IMotor 1 000 ms IMotor > lower current setting value IMotor < upper current setting value x 3.5 250 A 250 A 250 A B600 / R300 G: 500 A, Class L: 700 A gG: 500 A fuse gG: 6 A any
trip class design of the overload release response value current of the grounding protection minimum response time of the grounding protection in settled state operating range of the grounding protection relating to current set value • minimum • maximum UL/CSA ratings full-load current (FLA) for 3-phase AC motor • at 480 V rated value • contact rating of auxiliary contacts according to UL Short-circuit protection design of the fuse link • for short-circuit protection of the main circuit — with type of coordination 1 required — with type of assignment 2 required • for short-circuit protection of the auxiliary switch required Installation/ mounting/ dimensions mounting position fastening method	electronic 0.75 x IMotor 1 000 ms IMotor > lower current setting value IMotor < upper current setting value x 3.5
trip class design of the overload release response value current of the grounding protection minimum response time of the grounding protection in settled state operating range of the grounding protection relating to current set value • minimum • maximum UL/CSA ratings full-load current (FLA) for 3-phase AC motor • at 480 V rated value • at 600 V rated value contact rating of auxiliary contacts according to UL Short-circuit protection design of the fuse link • for short-circuit protection of the main circuit — with type of coordination 1 required — with type of assignment 2 required • for short-circuit protection of the auxiliary switch required Installation/ mounting/ dimensions mounting position fastening method height	electronic 0.75 x IMotor 1 000 ms IMotor > lower current setting value IMotor < upper current setting value x 3.5 250 A 250 A 250 A 250 A B600 / R300 G: 500 A, Class L: 700 A gG: 500 A fuse gG: 6 A any Contactor mounting/stand-alone installation 119 mm
trip class design of the overload release response value current of the grounding protection minimum response time of the grounding protection in settled state operating range of the grounding protection relating to current set value • minimum • maximum UL/CSA ratings full-load current (FLA) for 3-phase AC motor • at 480 V rated value • at 600 V rated value contact rating of auxiliary contacts according to UL Short-circuit protection design of the fuse link • for short-circuit protection of the main circuit — with type of coordination 1 required — with type of assignment 2 required • for short-circuit protection of the auxiliary switch required Installation/ mounting/ dimensions mounting position fastening method height width	electronic 0.75 x IMotor 1 000 ms IMotor > lower current setting value IMotor < upper current setting value x 3.5 250 A 250 A 250 A 250 A B600 / R300 GG: 500 A, Class L: 700 A gG: 500 A fuse gG: 6 A any Contactor mounting/stand-alone installation 119 mm 120 mm
trip class design of the overload release response value current of the grounding protection minimum response time of the grounding protection in settled state operating range of the grounding protection relating to current set value • minimum • maximum UL/CSA ratings full-load current (FLA) for 3-phase AC motor • at 480 V rated value • at 600 V rated value contact rating of auxiliary contacts according to UL Short-circuit protection design of the fuse link • for short-circuit protection of the main circuit — with type of coordination 1 required — with type of assignment 2 required • for short-circuit protection of the auxiliary switch required Installation/ mounting/ dimensions mounting position fastening method height width	electronic 0.75 x IMotor 1 000 ms IMotor > lower current setting value IMotor < upper current setting value x 3.5 250 A 250 A 250 A 250 A B600 / R300 G: 500 A, Class L: 700 A gG: 500 A fuse gG: 6 A any Contactor mounting/stand-alone installation 119 mm
trip class design of the overload release response value current of the grounding protection minimum response time of the grounding protection in settled state operating range of the grounding protection relating to current set value • minimum • maximum UL/CSA ratings full-load current (FLA) for 3-phase AC motor • at 480 V rated value • at 600 V rated value contact rating of auxiliary contacts according to UL Short-circuit protection design of the fuse link • for short-circuit protection of the main circuit — with type of coordination 1 required — with type of assignment 2 required • for short-circuit protection of the auxiliary switch required Installation/ mounting/ dimensions mounting position fastening method height width	electronic 0.75 x IMotor 1 000 ms IMotor > lower current setting value IMotor < upper current setting value x 3.5 250 A 250 A 250 A 250 A B600 / R300 GG: 500 A, Class L: 700 A gG: 500 A fuse gG: 6 A any Contactor mounting/stand-alone installation 119 mm 120 mm
trip class design of the overload release response value current of the grounding protection minimum response time of the grounding protection in settled state operating range of the grounding protection relating to current set value • minimum • maximum UL/CSA ratings full-load current (FLA) for 3-phase AC motor • at 480 V rated value • at 600 V rated value contact rating of auxiliary contacts according to UL Short-circuit protection design of the fuse link • for short-circuit protection of the main circuit — with type of coordination 1 required — with type of assignment 2 required • for short-circuit protection of the auxiliary switch required Installation/ mounting/ dimensions mounting position fastening method height width	electronic 0.75 x IMotor 1 000 ms IMotor > lower current setting value IMotor < upper current setting value x 3.5 250 A 250 A 250 A 250 A B600 / R300 GG: 500 A, Class L: 700 A gG: 500 A fuse gG: 6 A any Contactor mounting/stand-alone installation 119 mm 120 mm
trip class design of the overload release response value current of the grounding protection minimum response time of the grounding protection in settled state operating range of the grounding protection relating to current set value • minimum • maximum UL/CSA ratings full-load current (FLA) for 3-phase AC motor • at 480 V rated value • at 600 V rated value contact rating of auxiliary contacts according to UL Short-circuit protection design of the fuse link • for short-circuit protection of the main circuit — with type of coordination 1 required — with type of assignment 2 required • for short-circuit protection of the auxiliary switch required Installation/ mounting/ dimensions mounting position fastening method height width depth Connections/ Terminals product component removable terminal for auxiliary and	electronic 0.75 x IMotor 1 000 ms IMotor > lower current setting value IMotor < upper current setting value x 3.5 250 A 250 A 250 A 250 A B600 / R300 gG: 500 A, Class L: 700 A gG: 500 A fuse gG: 6 A any Contactor mounting/stand-alone installation 119 mm 120 mm 155 mm

 for auxiliary and co 			spring	g-loaded terminals			
arrangement of electrica circuit	al connectors for main	current	Top and bottom				
type of connectable con	ductor cross-sections	;					
 for auxiliary contact 	ts						
— solid			2x (0.	.25 1.5 mm²)			
 — solid or strand 	led		2x (0,	,25 1,5 mm²)			
- finely stranded	d with core end process	ing	2x (0.	.25 1.5 mm²)			
- finely stranded	d without core end proce	essing	2x (0.	2x (0.25 1.5 mm²)			
 for AWG cables for 	auxiliary contacts		2x (24	2x (24 16)			
tightening torque							
 for main contacts w 	vith screw-type terminals	3	20	22 N·m			
design of the thread of t	he connection screw						
 for main contacts 			M10				
Electrical Safety							
protection class IP on the front according to IEC 60529			IP00;	IP20 with box terminal/c	over		
touch protection on the	touch protection on the front according to IEC 60529			-safe, for vertical contac	t from the front with box te	rminal/cover	
Communication/ Protocol	-						
type of voltage supply v	ia input/output link ma	aster	No				
Electromagnetic compatil	· ·						
conducted interference			_				
due to burst accord	ling to IEC 61000-4-4		2kV	(nower ports) 1 kV (sign	al ports) corresponds to de	Paree of severity 3	
	arth surge according to	IEC 61000-4-5			ds to degree of severity 3	spice of seventy o	
	onductor surge according			(line to line) corresponds			
61000-4-5	-	-					
 due to high-frequer 4-6 	ncy radiation according t	to IEC 61000-	10 V	in frequency range 0.15	to 80 MHz, modulation 80	% AM with 1 kHz	
field-based interference	according to IEC 6100	00-4-3	10 V/	m			
electrostatic discharge	according to IEC 6100	0-4-2	6 kV (contact discharge / 8 kV	air discharge		
Display	-						
display version for switchi	na status		Slide	switch			
Approvals Certificates	3						
General Product Approv	val		-				
General Product Approv	val						
General Product Approv				Confirmation	0		
General Product Approv	UK	CE		Confirmation	መ	CO (
		CE		Confirmation	(h)	EAC	
General Product Approv	UK	C E EG-Konf.		Confirmation	U U	EAC	
	UKCA	C E EG-Konf.		Confirmation	U	EAC	
CCC	UK	EG-Konf.	ard-		U	EAC	
	UK		ard-	Confirmation Test Certificates	U	ERIC Marine / Shipping	
CCC	Val UK CA	For use in haza	ard-		UL UL Special Test Certific-	ERC Marine / Shipping	
CCC	UK CA	For use in haza	ard-	Test Certificates		ERC Marine / Shipping	
CCC	UK CA	For use in haza	ard-	Test Certificates	Special Test Certific-	EAC Marine / Shipping	
CCC	UK CA	For use in haza	ard-	Test Certificates	Special Test Certific-	EAC Marine / Shipping	
CCC	UK CA	For use in haza	ard-	Test Certificates	Special Test Certific-	EAC Marine / Shipping	
EMV EMV	UK CA	For use in haza	ard-	Test Certificates	Special Test Certific-	ABS	
CCC	UK CA	For use in haza	ard-	Test Certificates	Special Test Certific-	ERC Marine / Shipping ABS	
EMV EMV	UK CA	For use in haza	ard-	Test Certificates	Special Test Certific-	ABS	
EMV EMV	UK CA	For use in haza	ard-	Test Certificates Type Test Certificates ates/Test Report other	Special Test Certific- ate	ABS	
EMV EMV Marine / Shipping	KC Kegister	For use in haza	ard-	Test Certificates Type Test Certificates ates/Test Report other	Special Test Certific- ate	ABS Environment Environmental Con-	
EMV EMV	UK CA	For use in haza	ard-	Test Certificates Type Test Certificates ates/Test Report other	Special Test Certific- ate	ABS Environment Environmental Con-	
EMV EMV Marine / Shipping	KC Kegister	For use in haza	ard-	Test Certificates Type Test Certificates ates/Test Report other	Special Test Certific- ate	ABS Environment Environmental Con-	
EMV EMV Marine / Shipping	KC Kegister	For use in haza	ard-	Test Certificates Type Test Certificates ates/Test Report other	Special Test Certific- ate	ABS Environment Environmental Con-	
EMV EMV Marine / Shipping Marine / Shipping	KC LIS	For use in haza	ard-	Test Certificates Type Test Certificates ates/Test Report other	Special Test Certific- ate	ABS Environment Environmental Con-	
EMV EMV Marine / Shipping	KC KC	For use in haza ous locations	ard-	Test Certificates Type Test Certificates ates/Test Report other	Special Test Certific- ate	ABS Environment Environmental Con-	
EMV EMV Marine / Shipping Marine / Shipping Eurther information	KC KC aging emens.com/cs/ww/en/vito oadcenter (Catalogs, E	For use in haza ous locations	ard-	Test Certificates Type Test Certificates ates/Test Report other	Special Test Certific- ate	ABS Environment Environmental Con-	
EMV EMV Marine / Shipping Marine / Shipping Eurther information Information on the pack https://support.industry.sie Information- and Downle	KC KC aging emens.com/cs/ww/en/vio padcenter (Catalogs, E	For use in haza ous locations	ard-	Test Certificates Type Test Certificates ates/Test Report other	Special Test Certific- ate	ABS Environment Environmental Con-	
EMV EMV Marine / Shipping Marine / Shipping Marine / Shipping	KC KC aging emens.com/cs/ww/en/vir badcenter (Catalogs, E /ic10 dering system)	For use in haza ous locations		Test Certificates Type Test Certificates ates/Test Report other Miscellaneous	Special Test Certific- ate	ABS Environment Environmental Con-	
EMV EMV EMV EMV EMV EEMV ECM EMV EV EV EV EV EV EV EV EV EV EV EV EV EV	KC KC aging emens.com/cs/ww/en/vii oadcenter (Catalogs, E //c10 dering system) ens.com/mail/en/Cata	For use in haza ous locations	=3RB21	Test Certificates Type Test Certificates Type Test Certificates Type Test Certificates Test Report tother Other Miscellaneous 63-4GF2	Special Test Certific- ate	ABS Environment Environmental Con-	
EMV EMV EMV EMV EMV EMV EMV EMV EXAMPLE EXAMPL	KC KC aging emens.com/cs/ww/en/vii oadcenter (Catalogs, E //c10 dering system) ens.com/mail/en/Cata	For use in haza ous locations	=3RB21	Test Certificates Type Test Certificates Type Test Certificates Type Test Certificates Test Report tother Other Miscellaneous 63-4GF2	Special Test Certific- ate	ABS Environment Environmental Con-	

Service&Support (Manuals, Certificates, Characteristics, FAQs,...) https://support.industry.siemens.com/cs/ww/en/ps/3RB2163-4GF2 Image database (product images, 2D dimension drawings, 3D models, device circuit diagrams, EPLAN macros, ...) http://www.automation.siemens.com/bilddb/cax_de.aspx?mlfb=3RB2163-4GF2&lang=en Characteristic: Tripping characteristics, I²t, Let-through current https://support.industry.siemens.com/cs/ww/en/ps/3RB2163-4GF2/char Further characteristics (e.g. electrical endurance, switching frequency) http://www.automation.siemens.com/bilddb/index.aspx?view=Search&mlfb=3RB2163-4GF2&objecttype=14&gridview=view1

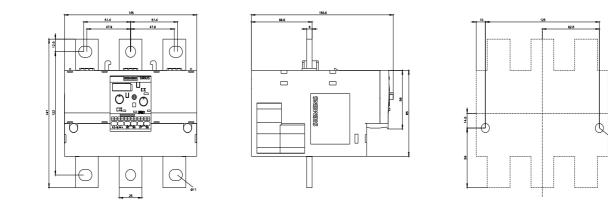

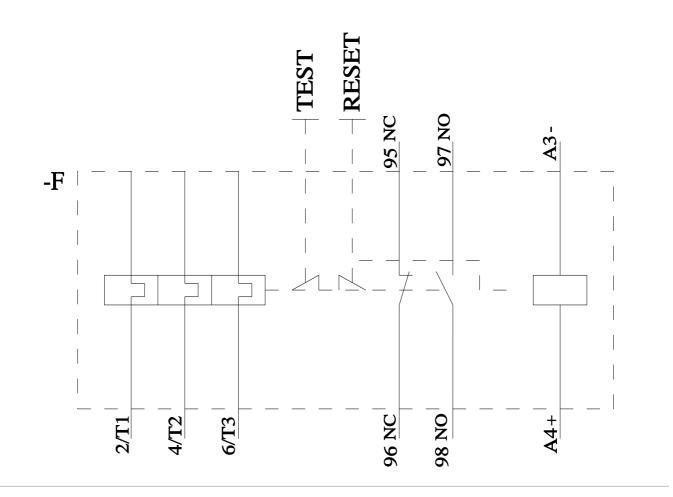

last modified:

3/11/2024 🖸

Mouser Electronics

Authorized Distributor

Click to View Pricing, Inventory, Delivery & Lifecycle Information:

Siemens:

3RB21634GF2